

Ref: 30/04023


Page 5 of 5

Client: Microgard Ltd

RALPH MANIKIN TEST – BURN INJURY PREDICTION AT 60s

CLOTHING SYSTEM: One clothing system, comprising:
 Outer layer: Microgard FR coverall with hood
 Middle layer: Roots FRA-02 Pyrovatex coverall
 Base layer: 100% cotton long sleeve T-shirt, Denim jeans

FLAME EXPOSURE TIME: 4 seconds (data acquisition time 60 seconds)

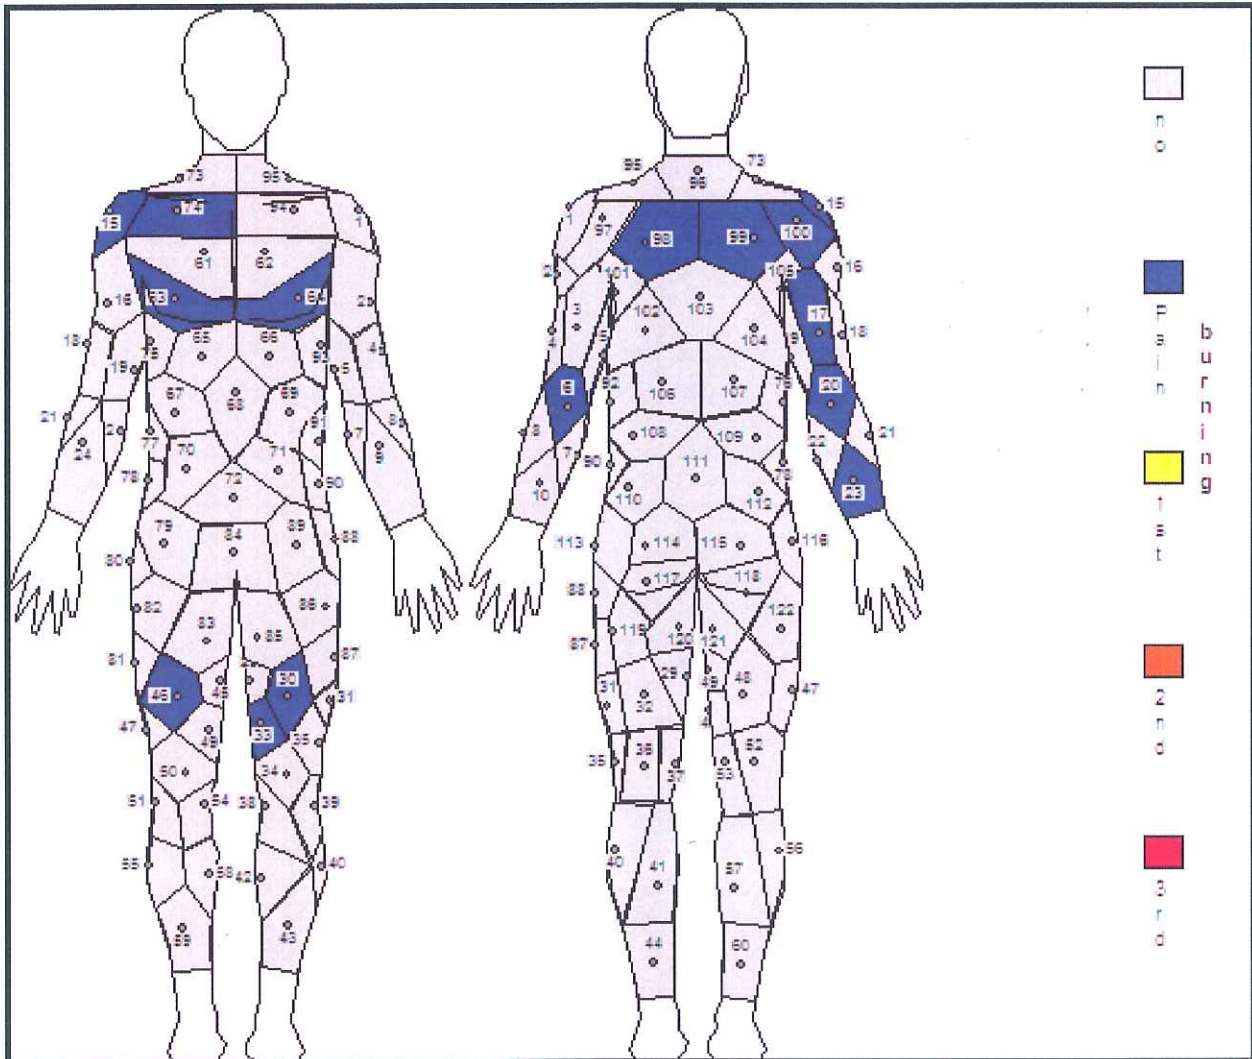

Burn Injury Prediction (according to ISO 13506 clause 9.5.3)

Pain	1st° Burn	2nd° Burn	3rd° Burn	2nd° + 3rd° Burn
12.3%	0%	0%	0%	0%



This report is incomplete without all the pages specified above,
 together with a copy of our standard terms of business.
 The supply of all goods and services is subject to our standard terms of business,
 copies of which are available on request or at www.bttg.co.uk/PDFs/Terms_Conditions.pdf
 Reg. Office: BTTG Testing & Certification Limited,
 Unit 14, Wheel Forge Way, Trafford Park, Manchester, M17 1EH, United Kingdom.
 Company No. 4669650 VAT No. 816 740 526
 © BTTG Testing & Certification Limited 2008